


To check aged degradation of insulating oil, degradation product in insulating oil is often measured. Furfural is one of a degradation product of cellulose composing insulating paper in insulating oil. Furfural is stably dissolved in oil and distinction of degraded state of oil can be confirmed by measuring the concentration of furfural.

In this technical note, we introduce a HPLC method and two sample preparation methods (liquid-liquid extraction and solid phase extraction with silica gel column) for monitoring furfural in insulating oil.


(K. Kanno)

Standard Solution

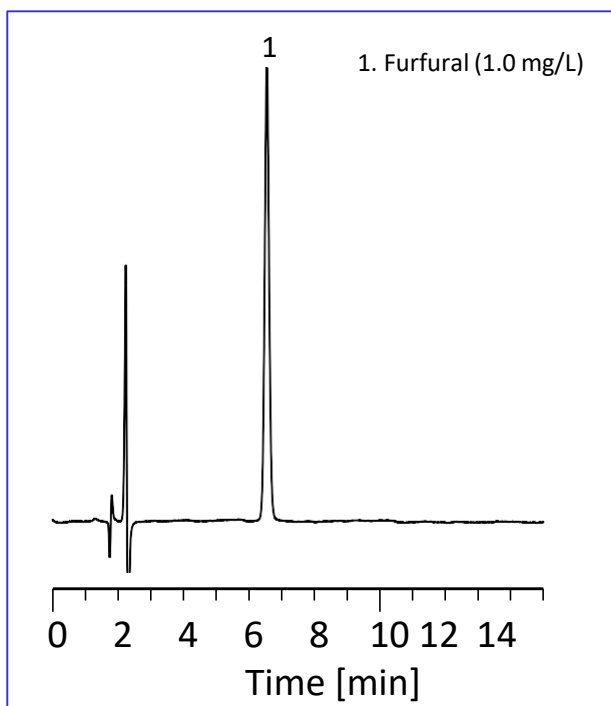

HPLC Conditions

System : LC800 UHPLC System
Column : InertSustain C18
 (5 μ m, 150 \times 4.6 mm I.D.)
Eluent : A) H₂O
 B) CH₃CN
 A/B = 90/10, v/v
 (Mixed by a gradient mixer)
Flow rate : 1.0 mL/min
Col. temp. : 40 $^{\circ}$ C
Detection : UV 278 nm
Inj. vol. : 10 μ L

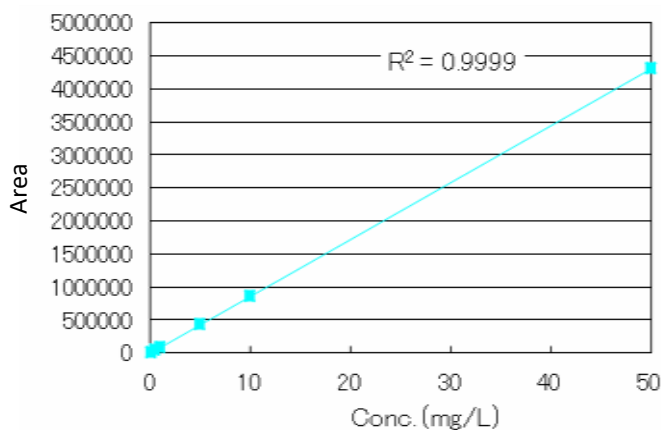


Calibration Curve

HPLC Column

InertSustain C18 5 μ m, 150 \times 4.6 mm I.D.
 Cat. No. 5020-07345

Sample Preparation Method Example ① (Solid phase extraction)

1. Furfural was added in fresh insulating oil as concentration of 1.0 mg/L.
2. SPE and HPLC were done five times.

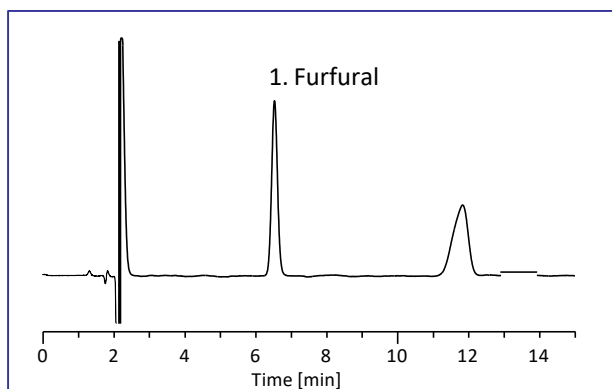

<i>n</i>	Recovery rate [%]
1	97.3
2	95.2
3	96.4
4	95.9
5	96.7
Average	96.3
CV [%]	0.82

SPE Column

InertSep SI FF (Fast Flow) 500 mg/6 mL
Cat. No. 5010-62344

1 mL of sample 1. was diluted
with 4 mL of *n*-Hexane

Conditioning

← *n*-Hexane (5 mL)InertSep SI FF
500 mg/6 mL

Wash

← *n*-Hexane (5 mL)

Drying


Elution

← CH₃CN (1 mL)

HPLC

Sample Preparation Method Example ② (Liquid-liquid extraction)

1. Furfural was added in fresh insulating oil as concentration of 1.0 mg/L (same sample of example ①).
2. Liquid-liquid extraction and HPLC were done five times.

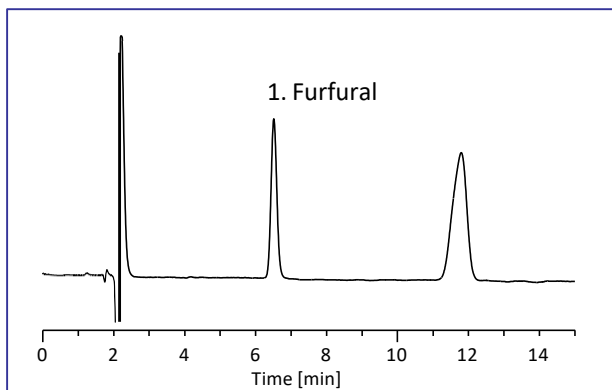

<i>n</i>	Recovery rate [%]
1	86.3
2	84.8
3	87.4
4	85.0
5	85.1
Average	85.7
CV [%]	1.29

2 mL of sample 1.

← CH₃CN (2 mL)

← Shaking (5 min)

← Settling (10 min)

← Upper layer

HPLC

GL Sciences disclaims any and all responsibility for any injury or damage which may be caused by this data directly or indirectly. We reserve the right to amend this information or data at any time and without any prior announcement.

GL Sciences, Inc. Japan

22-1 Nishishinjuku 6-Chome
Shinjuku-ku, Tokyo,
163-1130, Japan
Phone: +81-3-5323-6620
Fax: +81-3-5323-6621
Email: world@glsc.co.jp
Web: www.glsciences.com

GL Sciences B.V.

De Sleutel 9
5652 AS Eindhoven
The Netherlands
Phone: +31 (0)40 254 95 31
Email: info@glsciences.eu
Web: www.glsciences.eu

GL Sciences (ShangHai) Ltd.

Tower B, Room 2003,
Far East International Plaza,
NO,317 Xianxia Road,
Changning District.
Shanghai, China P.C. 200032
Phone: +86 (0)21-6278-2272
Email: contact@glsciences.com.cn
Web: www.glsciences.com.cn

GL Sciences, Inc. USA

4733 Torrance Blvd. Suite 255
Torrance, CA 90503
Phone: 310-265-4424
Fax: 310-265-4425
Email: info@glsciencesinc.com
Web: www.glsciencesinc.com

International Distributors

Visit our Website at:

<https://www.glsciences.com/company/distributor.html>